




\\corp.pbwan.net\Global\GB\Projects\UK0044xxx\UK0044022.9334 - Glanllynfi Garth wind farm - EIA and Planning\03 WPI\Drawings\ACAD\UK0044022.9334-WSPE-FG-OL-00013_P01.1.dwg Originator: UKBLB775

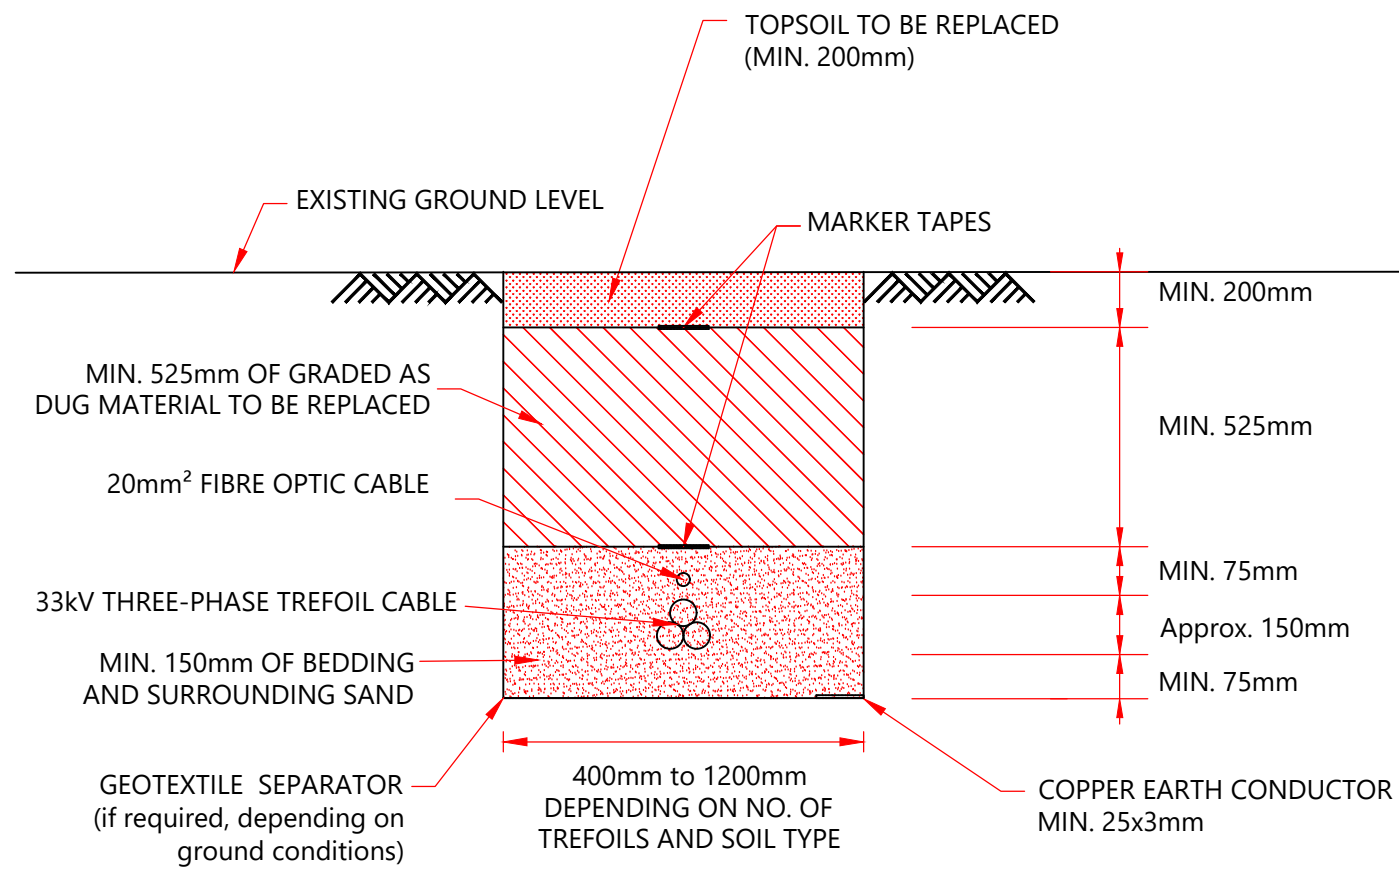

TYPICAL CABLE TRENCH DETAIL
(Typically adjacent to site tracks)

Notes:

1. Cable sites run adjacent to site roads.
2. Above ground cable markers to be located as required.

Not to scale

Client

PENNANT
WALTERS

Glanllynfi Garth Wind Farm
Environmental Statement
Chapter 4: Development Description

Figure 4.6
Typical cable trench details

July 2026

